


# VOLU-probe & VOLU-probe/SS

## MINIMUM QUANTITY OF PROBES

**NOTE**


Below VOLU-probe & VOLU-probe/SS installations  
assume compliance with proper probe orientation to, and  
required minimum distances from, air turbulence producing sources.

---

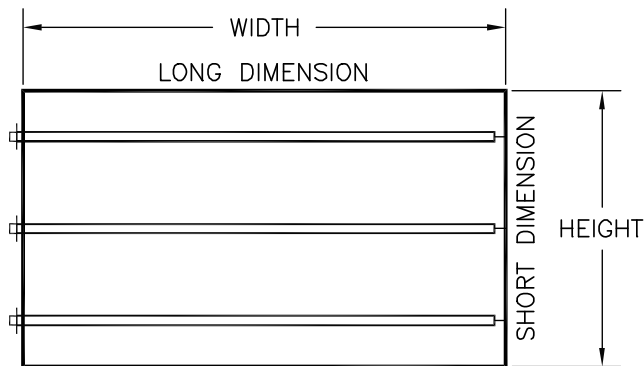

FOR SQUARE AND RECTANGULAR DUCTS

| Height Dimension | Min. Qty of VOLU-probes Recommended |
|------------------|-------------------------------------|
| 8" to 12"        | 1                                   |
| > 12" to 30"     | 2                                   |
| > 30" to 54"     | 3                                   |
| > 54" to 84"     | 4                                   |
| > 84" to 120"    | 5                                   |
| > 120" to 180"   | 6                                   |

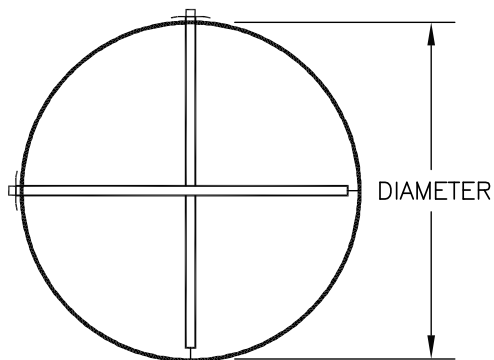

FOR CIRCULAR DUCTS

| Diameter     | Min. Qty of VOLU-probes Recommended |
|--------------|-------------------------------------|
| 8" to 18"    | 1                                   |
| > 18" to 72" | 2                                   |
| > 72"        | 3                                   |

